


AT10.1 RACK-MOUNTING CHART
(SEE NOTE 1)

EIA RACK WIDTH	19 INCH	23 INCH	24 INCH
RACK MTG WIDTH	18.31	22.31	23.31
STYLE-586 ENCL	MTG "E"	MTG "B"	MTG "A"
STYLE-594 ENCL	N/A	MTG "D"	MTG "C"

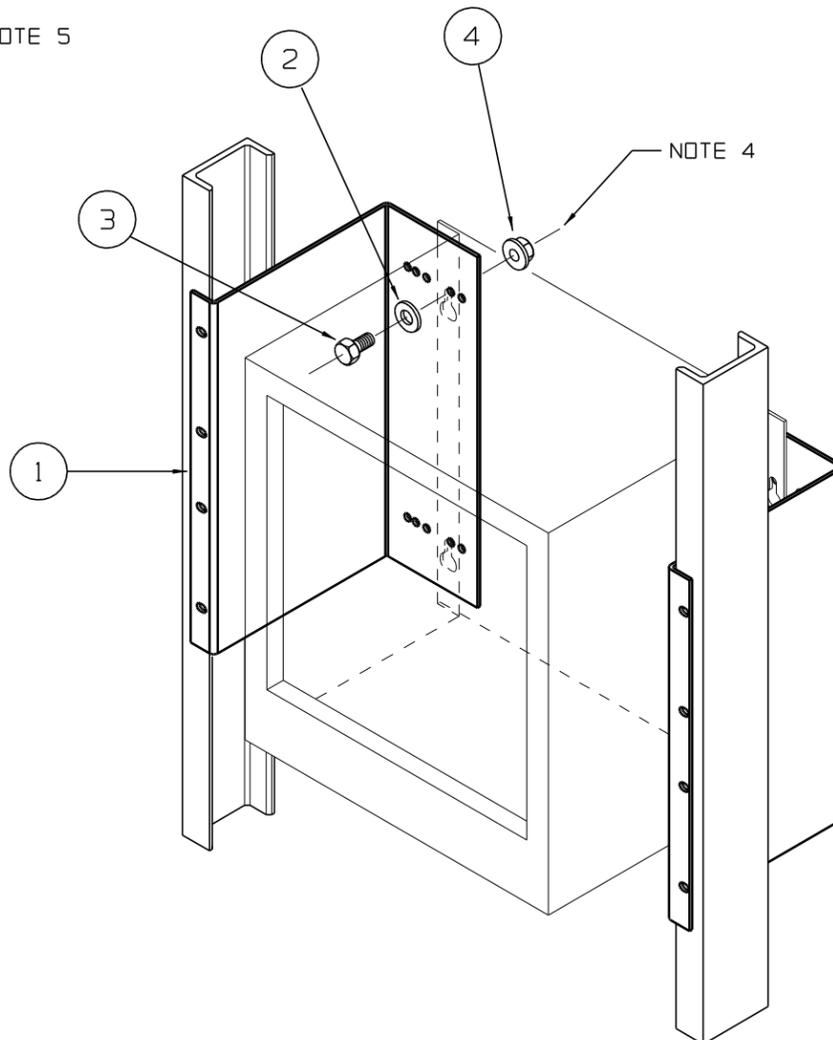

RECOMMENDED PROCEDURE

- 1) DETERMINE RACK WIDTH FROM CHART.
- 2) DETERMINE ENCLOSURE SIZE FROM DRAWING.
- 3) POSITION ITEM 1 ONTO BACK OF AT10.1, SELECT PROPER MOUNTING LOCATION (A THRU E), CHECK THAT RACK MOUNTING WIDTH MATCHES YOUR RACK MOUNTING WIDTH.
- 4) FASTEN TOGETHER WITH ITEM 2, ITEM 3, AND ITEM 4 IN FOUR (4) PLACES, REFER TO DRAWING. RECOMMENDED TORQUE IS 57-77 in-lbs.
- 5) MOUNT COMPLETE ASSEMBLY TO RACK WITH USER-SUPPLIED HARDWARE.
- 6) IF MULTIPLES CHARGERS ARE INSTALLED INTO A SINGLE RACK, 6in / 162mm MINIMUM SPACING IS REQUIRED ABOVE AND BELOW UNITS FOR COOLING.

BILL OF MATERIAL: EI0193-00

ITEM NUMBER	PART No.	DESCRIPTION	QUANTITY PER ASSY
①	FC0609-00	RACK MOUNTING BRACKET	2
②	PE0004-08	WASHER, ZPS, FLAT 0.25"	4
③	PE0025-02	SCW, ZPS, HHTB 0.25-20x0.75	4
④	PE0269-07	NUT, ZPS, 0.25-20, SER-HX-FG-LK	4
	JA0091-00	CUSTOMER INSTRUCTIONS	1

				 THIRD ANGLE PROJECTION			
				DRAWN BY	050393	TITLE AT10.1 SERIES: GROUP I RACK-MOUNTING CUSTOMER INSTALLATION INSTRUCTIONS	
				APPROVED	WAH 050393	DRAWING No JA0091-00	
1	21593	040209	ND	UNLESS OTHERWISE NOTED DIMENSIONS ARE IN INCHES. TOLERANCES ARE:		REV 1	B
0	9736	042393	WAH	SCALE	NTS	PART No JA0091-00	SHEET 1 OF 1
REV	ECN No	DATE	APP				